


## % of Data Exceeding Chlorophyll-a Standard of 40 ug/L Based on 2005-2007 Monitoring Data

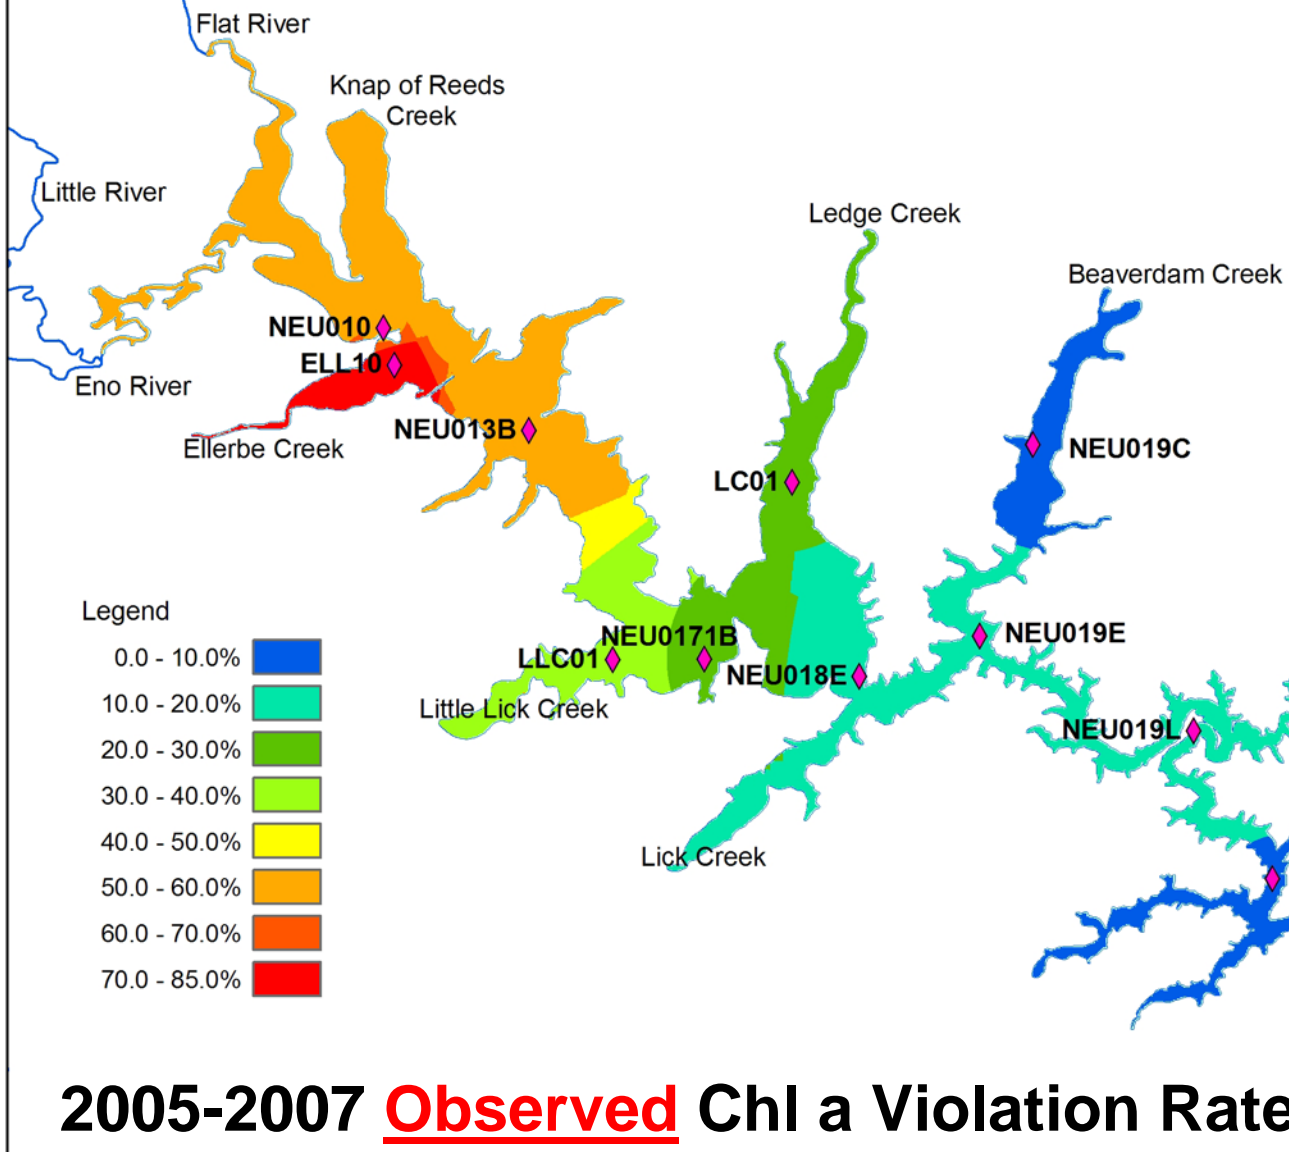

Station	% exceeding chla 40 ug/L*
<b>Mainstem</b>	
NEU010	53%
NEU013B	53%
NEU0171B	25%
NEU018E	16%
NEU019E	16%
NEU019L	12%
NEU019P	10%
NEU020D	10%
<b>Coves</b>	
<b>ELL10</b>	<b>84%</b>
LC01	21%
LLC01	39%
<b>Beaverdam Creek</b>	
NEU019C	4%

**2005-2007 Observed Chl a Violation Rate**